

**2005 – 2006 Supplement
ANNUAL WATER QUALITY REPORT
BUFFALO WATER AUTHORITY
PWS ID # NY0000422**

*City of Buffalo - Division of Water
Managed by*



**Byron W. Brown
Mayor**

**Joseph N. Giambra
Commissioner of Public Works**

**Victoria J. Saxon
Chairperson, Buffalo Water Board**

**Stephen Siegfried
Regional Manager, American Water**

**James Campolong
Project Manager, American Water**



**Buffalo's Water Front
Water is Life ... Don't Waste
It!
[Next](#)**

Table of Contents

- [Buffalo Water Authority information](#)
- [Introduction](#)
- [Abbreviations & Definitions](#)
- [History of Water Treatment](#)
- [SWAP Report](#)
- [Formation of the Great Lakes](#)
- [Raw Water Source](#)
- [Water Treatment](#)
- [Water Treatment Schematic](#)
- [Water Distribution](#)
- [Customer Costs](#)
- [Facts About Cryptosporidium](#)
- [Facts About Giardia](#)
- [Facts About Radon](#)
- [Aesthetic Qualities](#)
- [Zebra Mussels](#)
- [Metering Program](#)
- [Water Conservation](#)
- [Water Savings Tips](#)
- [More Water Savings Tips](#)
- [Consumer Tips](#)
- [FAQ – Water Quality](#)
- [FAQ – Meters & Billing](#)
- [2005 System Improvements](#)
- [Future of Buffalo’s Water System](#)
- [Are there contaminants in our Drinking Water?](#)
- [2005 Table of Detected Contaminants](#)
- [What does this information mean?](#)
- [2005 Raw Water Data](#)
- [Undetected Contaminants](#)
- [Is our Water System Meeting other rules that govern operations?](#)
- [Closing](#)

[Back](#)

[Next](#)

[Buffalo Water Board Members](#)
[Important Telephone #](#)
[Water Treatment Plant Address & Telephone number](#)
[Billing office Address & Telephone number](#)
[Important Service Numbers To Report Leaks](#)
[Billing & Customer Service Telephone number](#)

[Service Inspections - Final Reads on Meter](#)
[Meter Installation Telephone number](#)
[Meter Repair Telephone number](#)
[Filter Plant Telephone number](#)
[Filter Plant Laboratory Telephone number](#)
For Health Issues contact the [Erie County Health Dept](#)

BUFFALO WATER AUTHORITY INFORMATION

Buffalo Water Board

Victoria J Saxon
Chairperson

Warren Galloway
Vice Chairperson

Board Members

**Ronald F
Mandell**

**Charles E
McGriff**

**James B
Milroy**

**John R
Sole**

Important Service Numbers

Billing Office	716 – 847 - 1065	For billing questions & service problems
Customer Service		
Dispatch	716 – 851 - 4747	To Report Leaks
	716 – 851 - 4748	
	716 – 851 - 4749	
Meter Installations	716 – 852 - 0197	
Meter Repair	716 – 851 - 4741	
Service Inspections	716 – 851 – 4782	Final reads on meter
Water Treatment Plant	716 – 851 – 4720	
Water Treatment Plant Laboratory	716 – 851 - 4704	Water quality complaints & questions
Water Treatment Supervisor	716 – 851 - 4726	
Erie County Dept. of Health	716 - 858 - 7677	For health issues
<i>City of Buffalo Web site: http://www.ci.buffalo.ny.us/</i>		

***Billing & Customer Service
American Water
281 Exchange Street
Buffalo, NY 14204***

***Water Treatment Plant
American Water
2 Porter Avenue
Buffalo, NY 14201
PWS ID # NY0000422***

[Table of Contents](#)

[Next Page](#)

Introduction

Este informe contiene información muy importante sobre su agua beber. Tradúzcalo ó hable con alguien que lo entienda bien

The following is the 12th annual water quality report prepared by the Buffalo Water Authority managed by [American Water](#). The purpose of this report is to raise your understanding about drinking water and awareness of the need to protect our drinking water source. This report provides an overview of last year's water quality. Included are details about where your water comes from, what it contains, and how it compares to State standards. We are pleased to provide you with this information because informed customers are our best customers.


Last year, your tap water met all state and federal drinking water health standards. We are proud to report that our system did not violate a [maximum containment level](#) or any other water quality standard. During 2005, our system was in compliance with all applicable state drinking water operating, monitoring and reporting requirements.

If you have any questions about this report or concerning your drinking water, please contact:

Leonard Milioto
Water Treatment Supervisor
2 Porter Ave, Buffalo, NY 14201
Tel: (716) 851-4726, Fax: (716) 851-4672

We want you to be informed about your drinking water. If you want to learn more, please attend any regularly scheduled Water Board meetings. For times and location, please see the local newspaper.

[Back](#) [Table of Contents](#) [Next Page](#)

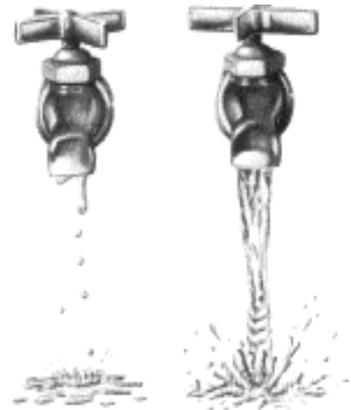

**For Health Issues contact:
Erie County Health Department
95 Franklin Street
Buffalo, NY 14202
(716) 858-7677**

Abbreviations & Definitions

AL (Action Level): The concentration of a [contaminant](#), which, if exceeded, triggers a [treatment](#) or other requirement, which a water system must follow.

Backwash, Backwash Water: A backward flow of water through a [filter bed](#), allowing trapped debris and [floc](#) to be cleared from the filter media.

Back to: [Treatment](#); [sludge](#); [Thickening Tanks](#); [Washwater Tanks](#);

Backwash Station: An area, just downstream from the [equalization](#) station, where backwash water, from the filter cleaning process, is pumped to the [Thickener](#) Tanks.

Chlorine: A highly reactive gas, used as a [disinfectant](#) in water treatment.

Back to: [History](#); [Treatment](#);

Clearwell: A finished water storage area. Filtered water enters the Clearwell from the [filter beds](#). Clearwell water is pumped to the [distribution system](#), once it is treated with [orthophosphate](#).

Back to: [Treatment](#); [Water Distribution](#);

Coagulant: A material, such as PACl ([polyaluminum chloride](#)), which will form a precipitate in water, and cause the agglomeration of finely divided particles into larger particles, which can then be removed by settling and/or filtration.

Back to: [History](#) ; [Treatment](#);

Coliform, Coliform bacteria: A group of bacteria that are normally abundant in the intestinal tracts of human and other warm-blooded animals and are used as indicators (being measured as the number of individuals found per 100 milliliter of water) when testing the sanitary quality of water.

Contaminant: Any physical, chemical, biological, or radiological substance or matter in water that may be harmful to human health or which degrades the palatability of water.

Back to: [Action Level \(AL\)](#) [MCL](#); [MCLG](#); [TT \(Treatment Technique\)](#); [Raw Water Source](#);

Decant: The draw off from the upper layer of liquid after the heaviest material has settled

Back to: [Treatment](#); [Thickening Tanks](#);

Disinfection, Disinfectant: is a treatment, which destroys or renders inactive, harmful microorganisms (bacteria, viruses and cysts) to levels deemed to be safe by public health standards; viable microorganisms may still be present.

Back to: [Chlorine](#); [MRDL](#); [Water Treatment](#);

Disinfection By-Products (DBP): Byproducts of the disinfection of water by chlorine and chlorine compounds. DBP are regulated by the EPA because they are considered harmful in concentrated amounts. [Trihalomethanes \(THM's\)](#) and [Halogenated Acetic Acids \(HAA's\)](#) are among the most regulated DBP's.

Back to: [TOC's](#);

Distribution System: The system of pipes and valves supplying water to communities and industries.

Back to: [Clearwell](#);

Abbreviations & Definitions continued

Equalization Basin: An area upstream from the [filter beds](#) that collects backwash water from the filter cleaning process. The backwash contents from the equalization basin are directed into the [backwash station](#).

Filter Beds: 40 rapid, anthracite sand, filters designed to remove undissolved or suspended particles from water by recirculating the water through anthracite media. Filtered water is directed into the [Clearwell](#) to await distribution demand.

Back to [Backwash](#) ; [Equalization Station](#) ; [History](#); [Treatment](#); [settling basins](#); [Washwater Tanks](#);

Filter Aid: A [nonionic polymer](#) or a positively charged [coagulant](#) such as [polyaluminum chloride](#) used to “tighten” filters, and improve filtration. A filter aid is only used, when necessary.

Back to: [Treatment](#);

Floc: The clumps or tufts formed when suspended particles combine with chemical substance or compound that promotes the combination, agglomeration, aggregation or coagulation of suspended particles in the water.

Back to: [Treatment](#); [Backwash](#); [nonionic polymer](#); [polyaluminum chloride](#); [settling basins](#); [sludge](#);

Flocculation Chambers: Chambers with large, slow moving paddles. The slow mixing action promotes floc formation.

Back to: [Treatment](#); [low lift pumps](#);

Fluoride: Sodium silicofluoride, a fluoride compound added to drinking water, to promote dental health.

Back to: [Treatment](#);

HAA (Halogenated Acetic Acids): Organic compounds, which are [disinfection by-products](#) of the chlorination of drinking water, currently the EPA lists HAA’s as a health advisory

Intake: A structure located in the Emerald Channel at the Northeastern portion of Lake Erie, just downstream from the Niagara River, which provides source water for Buffalo Water Authority’s water treatment process.

Back to: [History](#); [Treatment](#);

Low Lift Pumps: Centrifugal pumps that direct water from the [raw water conduit](#) to the underground [flocculation](#) and [settling basins](#).

MCL (Maximum contaminant level): The highest level of [contaminant](#) that is allowed in drinking water. MCLs are set as close to the [MCLGs](#) as feasible using the best available treatment technology

Back to [Introduction](#); [THM \(Trihalomethanes\)](#);

MCLG (Maximum contaminant level goal): The level of [contaminant](#) in drinking water below which there is no known or expected risks to health, MGLGs allow for a margin of safety.

MRDL (Maximum Residual Disinfectant Level): The highest level of a [disinfectant](#) (chlorine) allowed in drinking water (4.0 ppm). There is convincing evidence that addition of a disinfectant is necessary for control of microbial contaminants.

Abbreviations & Definitions continued ...

n/a (NA): Not any. NLS: No limit set. ND: Not Detected.

NTU (Nephelometric Turbidity Units): A measure of clarity ([turbidity](#)) of water; turbidity in excess of 5NTU is just noticeable to the average person.

Ortho- phosphate: A chemical blend used as a [TT](#) (Treatment Technique) used to reduce the level of lead and copper contamination in drinking water.

Back to: [Treatment](#); [Clearwell](#);

Nonionic polymer: A long-chained, non-charged compound used to concentrate [floc](#) into [sludge](#), and also used as a [filter-aid](#), in the water treatment process

Back to: [Treatment](#); [Thickening Tanks](#);

Pathogenic: Disease causing

Back to [History](#);

ppb: Parts per billion, or micrograms per liter ($\mu\text{g/L}$).

ppm: Parts per million, or milligrams per liter (mg/L).

Polyaluminum Chloride: A [coagulant](#) used in water treatment, used to form [floc](#) and also used as a [filter-aid](#), in the water treatment process

Back to: [Treatment](#);

Potable water: water of a quality suitable for drinking, that meets drinking water standards.

Back to: [Treatment](#); [Washwater Tanks](#);

Rapid Mix (Chemical Induction Unit): A structure designed to mix chemicals in the [treated water conduit](#).

Raw Water: Lake Erie water, used by the Buffalo Water Authority as its [source water](#).

Raw Water Conduit: Large metal pipe bringing untreated lake water from the intake to the onshore [screen house](#), then to the chemical treatment points at the water treatment plant.

Back to: [Treatment](#); [Low Lift Pumps](#);

Screen House: An onshore treatment building containing a series of large, traveling screens. These screens are designed to remove large objects and debris from lake water prior to chemical water treatment.

Back to: [Treatment](#); [raw water conduit](#);

Sedimentation, Settling: The process of suspended solid particles settling out (going to the bottom of the vessel) in water.

Back to: [Water Treatment](#)

Settling Basins: Large, underground basins allowing heavy [floc](#) to settle out of treated water, prior to [filtration](#). The Buffalo Water Authority has 2 settling basins, north & south.

Back to: [Treatment](#); [low lift pumps](#);

Sludge: Concentrated [backwash floc](#). Sludge is directed to an onsite lagoon.

Back to: [Treatment](#); [Thickening Tanks](#); [nonionic polymer](#);

Source Water: See [Raw Water](#).

Abbreviations & Definitions continued....

Thickening Tanks: An onsite [backwash](#) treatment facility designed to concentrate and separate filter backwash into its' [sludge](#) and [decant](#) components. The Thickening Tanks use a [nonionic polymer](#) and settling tubes to treat filter [backwash](#).

Back to: [Treatment](#); [Backwash Station](#);

TOC (Total Organic Carbon); SUVA (Specific Ultraviolet Absorption); DOC (Dissolved Organic Carbon); UV₂₅₄: A measure of the organic content of the water. This is a precursor to [disinfection by-product](#) when combined with the chlorination of drinking water

Treated Water Conduit: Large metal pipe directing chemically treated water to various stages of the water treatment process.

Back to: [Rapid Mix](#);

TT (Treatment Technique): A required process intended to reduce the level of [contamination](#) in drinking water.

[Back to AL orthophosphate](#);

TTHM (Total Trihalomethane): Organic compounds, which are [disinfection by-products](#) of the chlorination of drinking water. Some people who drink water with TTHMs in excess of the [MCL](#) over many years may experience problems with their liver, kidneys, or central nervous system, and may have an increased risk of getting cancer.

Back to: [DBP](#)

Turbidity is a measure of the cloudiness of the water. We monitor it because it is a good indicator of the effectiveness of our filtration system. State regulations require that turbidity must always be below 5 NTU. The regulations require that 95% of the turbidity samples collected have measurements below 0.5 [NTU](#).

Back to: [History](#)

Washwater Tanks: Tanks, holding [potable water](#), used to [backwash filter beds](#).

Weir: is a structure that extends across the width of a channel and is used to impound, measure, or in some way alter the flow of water through the channel.

Back to: [Treatment](#);

90th % Value: The value reported for lead & copper represents the 90th %. A % is a value on a scale of 100 that indicates the % of a distribution that is equal to or below it. The 90th % is equal to or greater than 90% of the lead & copper values detected at your water system.

History of Water Treatment

The need for a clean, safe and reliable source of water has been a driving force of human civilization. Population centers would accumulate and grow around areas of clean water. Ancient humans recognized that a source of nearby water was a necessity. Its presence was essential to all life, not just for their own uses, but critical for the animals they hunted, and plants they harvested.

4000 years ago, in India and parts of China, the Hindu's devised the first recorded drinking water standards. It directed its people to heat foul water by boiling and exposing to sunlight and by dipping seven times into a piece of hot copper, then to filter and cool in an earthen vessel.

This enlightened treatment not only produced aesthetically acceptable water, but a disinfected potable source. This treatment was a directive intended for individuals and families, not a community water supply.

Only after the Dark Ages, due to advances in science and technology, was there a realization that clean looking water was not necessarily safe water. Before the invention of the microscope, the idea of microscopic life was unimagined. Even with that tool it still took over 200 years before a connection between microbes and disease was made. In the mid 19th Century it was proven that cholera was spread by contaminated waters. By the late 19th Century, Louis Pasteur developed the particulate germ theory of disease, which finally established a cause and effect relationship between microbes and disease.

Filtration of water was established as a method of clarifying water in the 18th Century. In 1832 the first municipal water treatment plant was built in Scotland. Unfortunately the aesthetic properties of the water were the major concerns of the time, while effective water quality standards remained absent until the late 19th Century.

In the US, municipal water systems originated as early as 1799, by 1860 over 400 were in service providing water to major cities and towns. Because water quality standard were lacking, these systems contributed to major outbreaks of disease by spreading [pathogenic](#) organisms.

In the 1890's effective water treatment techniques began to develop. [Coagulation](#) and [rapid sand filtration](#) were instituted, which significantly reduced both [turbidity](#) and bacteria in water supplies. [Chlorination](#) of water was eventually introduced in 1908. Finally a community's water supply could, in fact, be considered safe.

Buffalo's water system history began in 1827, when the Buffalo & Black Rock Jubilee Water Works was formed. It supplied well and spring water through an assemblage of wooden pipes. In 1852 the Buffalo Water Works Co. formed, and pumped its water from the Niagara River. The City of Buffalo purchased both companies in 1868 and began construction of an Intake and tunnel system in the Niagara River. This location proved unfortunate. River turbulence and shoreline pollution caused a public outcry for a new intake. In 1913 this new [intake](#) was completed. It was located upstream from the original one, in Lake Erie's Emerald Channel. In 1914 Buffalo began chlorinating its delivered water, and in 1926 the Water Treatment Plant was built utilizing [coagulation](#) and [filtration](#) along with disinfection of its delivered water.

[Back](#)

[Table of Contents](#)

[Next](#)

Source Water Assessment Program

A source water assessment was completed under the NYS DOH's Source Water Assessment Program (SWAP). The following is the Executive Summary of this report.

“The New York State Department of Health recently completed a draft Source Water Assessment of the raw water supply's source under the state's Source Water Assessment Program (SWAP). The purpose of this program is to compile, organize, and evaluate information regarding possible and actual threats to the quality of public water supply (PWS) sources. It is important to note that source water assessment reports estimate the potential for untreated drinking water sources to be impacted by contamination. These reports do not address the safety or quality of treated finished potable tap water. The Great Lakes' watershed is exceptionally large and too big for a detailed evaluation in the SWAP. General drinking water concerns for public water supplies which use these sources include: storm generated turbidity, wastewater, toxic sediments, shipping related spills, and problems associate with exotic species (e.g. zebra mussels – intake clogging and taste and odor problems). The SWAP is based on the analysis of the contaminant inventory compiled for the drainage area deemed most likely to impact drinking water quality at this public water supply raw water intake. This assessment found a moderate susceptibility to contamination for this source of drinking water. The amount of agricultural lands in the assessment area results in elevated potential for protozoa and disinfection byproduct precursor contamination. There is also a high density of sanitary wastewater discharges which results in elevated susceptibility for nearly all contaminant categories.

There is also noteworthy contamination susceptibility associated with other discrete contaminant sources, and these facility types include: Toxics Release Inventory facilities, Chemical Bulk Storage facilities, inactive hazardous waste sites, landfills and Resource Conservation and Recovery Act facilities.

If you have any questions about the state's Source Water Assessment Program, please contact

Ms. Dolores Funke, P.E.,

Senior Public Health Engineer

Erie County Health Department at 858-6966..”

For a complete copy of this report, contact the Erie County Health Department at 716-858-7677.

Formation of the Great Lakes

One billion years ago

About a billion years ago, a fracture in the earth running from what is now Oklahoma to Lake Superior generated volcanic activity that almost split North America. Over a period of 20 million years, lava intermittently flowed from the fracture creating mountains covering the regions now known as northern Wisconsin and Minnesota, and eastern Canada. Over time these mountains eroded, while occasional volcanic activity continued. Molten magma below the highlands of what is now Lake Superior spewed out to its sides, causing the highlands to sink and form a mammoth rock basin that would one day hold Lake Superior. Eventually the fracture stabilized and, over time, the rock tilted down from north to south.

5 Million Years Ago


The region went from fire to ice with the arrival of the glaciers, which advanced and retreated many times over the last 5 million years. During the periods of glaciation, giant sheets of ice flowed across the land, leveling mountains and carving out massive valleys. Where the glaciers encountered more resistant bedrock in the north, only the overlying layers were removed. To the south, the softer sandstones and shales were more affected. As the glaciers melted and began receding, their leading edges left behind high ridges, some of which can be seen today in the cliffs of Door County, Wisconsin, and the Bruce Peninsula in Ontario.

Huge lakes formed between these ridges from the retreating ice fronts, and continually changed over time as the ice sheet moved northward. Early drainage from these lakes flowed southward through the present Illinois River Valley toward the Mississippi River, through the Trent River Valley between present lakes Huron and Erie and through the Lake Nipissing-Ottawa River Valley from Georgian Bay on Lake Huron downstream to Montreal, Quebec.

As the ice retreated about 7,000 years ago, the Saint Lawrence Seaway established itself as the outlet to the Atlantic Ocean

About 4000 years ago lake levels dropped to current levels and present day river and stream inlets and outlets developed.

Formation of the Great Lakes One Continuous Channel Way

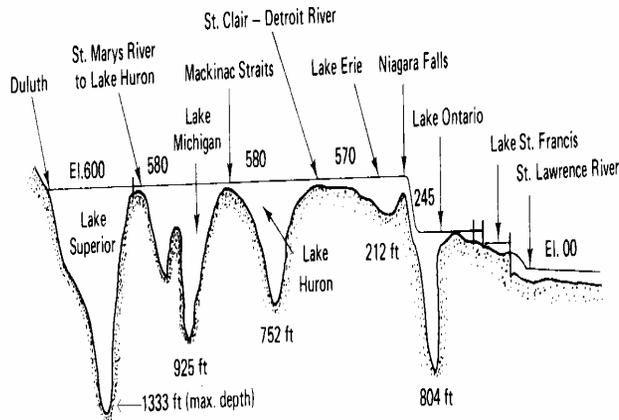

Four of the five Great Lakes are at different elevations, leading like a series of steps toward the Atlantic Ocean. The five individual lakes are connected to each other through channel ways, forming one system. Water continually flows from the headwaters of the Lake Superior basin through the remainder of the system.

The International Joint Commission, a binational agency established under the Boundary Waters Treaty of 1909 between Canada and the U.S., has the responsibility for regulation of flows on the St.

Mary's and the St. Lawrence Rivers. These channels have been altered by enlargement and placement of control works associated with deep-draft shipping. Agreements between the U.S. and Canada govern the flow through the control works on these connecting channels.

[Back](#)

[Table of Contents](#)

[Next Section](#)



Raw Water Source

IN GENERAL

The sources of drinking water (both tap and bottled) include rivers, lakes, streams, ponds, reservoirs, springs and wells. As water travels over the surface of the land or through the ground, it dissolves naturally occurring minerals and, in some cases, radioactive materials, and can pick up substances resulting from the presence of animal or human activities. [Contaminants](#) that may be present in source water include: microbial contaminants; inorganic contaminants; pesticides and herbicides; organic chemical contaminants; and radioactive contaminants. In order to ensure that tap water is safe to drink, the State and EPA prescribe regulations which limit the amount of certain contaminants in water provided by public water systems.

The State Health Department and FDA's regulations establish limits for contaminants in bottled water, which must provide the same protection for public health.

The source of all Buffalo's water is Lake Erie.



Lake Erie is the shallowest of the Great Lakes, with an average depth of only 62-ft. It also has the shortest detention time of the Great Lakes. Water remains in the lake for only 2.6 years before it is replaced by fresh water (as compared with 191 years in Lake Superior or 22.6

years in Lake Huron). It is also the siltiest of the Great Lakes. Its bottom consists of finely graded sand, easily upset during turbulent storms.

The combination of its shallowness, short detention time and sandy unstable bottom bestows a great asset upon this body of water. The lake is able to quickly flush itself of harmful contaminants such as pesticides and other organic wastes. When Lake Erie becomes turbulent, fine particles of sand and silt become agitated and suspended throughout the lake. Organic contaminants will tightly cling to these particles and will be quickly flushed from the lake. Therefore water treatment begins as a natural process due to the structure and makeup of Lake Erie.

Lake Erie Facts and Figures

Lake Erie is the 11th largest world lake - (4th largest Great Lake by surface area)

Length: 241 miles; Width: 57miles; Avg. Depth: 62'; Max Depth: 210'

Vol.: 116 miles³; Elevation: 569'; Shoreline: 871miles; Surface area: 9,910 miles²

Drainage Basin Area: 30,140 miles²; Outlet: Niagara River & Welland Canal

Water Treatment



Buffalo's water [intake](#) is located in the northeastern region of Lake Erie, just before water enters the Niagara River. This region is known as the Emerald Channel, due to the sparkling clarity of its water. Water rushes into the intake through grates and collects in a circular pool where it drops 60 feet to a 12-foot diameter, mile-long tunnel burrowed under the lakebed. The water is gravity fed to an onshore [screen house](#) where traveling screens remove large objects

such as sticks and other debris that can damage pumps.

Gravity delivers the water through a conduit where [chlorine](#), [fluoride](#), and [polyaluminum chloride](#) (PACl) are added. Chlorine is used to [disinfect](#) the water, control zebra mussels and other organisms. Fluoride is added to guard against tooth decay. PACl is a chemical [coagulant](#) designed to cause fine particles in the water to bind together forming [floc](#).

Pumps mix and direct the water to a rapid mix where additional PACl is added at a Rapid Mix to enhance coagulation. The flow is directed to underground basins for [flocculation](#) and [sedimentation](#).

At the flocculation area, the water is slowly mixed by mechanical paddles to enhance [floc](#) formation. This treated water then travels to the [settling basins](#) where the heavy floc is allowed to settle out by gravity. .

The water, still containing light floc, is directed over [rapid sand filter beds](#) where filtration occurs, removing fine floc. A [filter aid](#) (a [polyaluminum chloride](#) (PACl)) is added, when necessary, to enhance filtration. This filtered water enters the [Clearwell](#), where it is stored until needed in the distribution system.


The rapid sand filters occasionally need to be cleaned of trapped debris; this is done by [backwashing](#) the filters with [potable](#) water stored in our washwater tanks. To comply with EPA's Filter Backwash Recycle Rule the [backwash](#) water, containing filter bed debris, is recycled back to the [raw water conduit](#) after [sludge](#) production in the [Thickening Tanks](#).

The Thickening Tanks concentrate the debris into sludge using a nonionic polymer and settling tubes. The sludge portion is directed by pumps to an onsite lagoon where further processing takes place before removal to a landfill. The [decant](#) portion is directed over a [weir](#) at the top of the Thickening Tanks to the [Raw water conduit](#), where the water treatment process begins.

As the potable water leaves the plant, a corrosion control additive (a [sodium orthopolyphosphate blend](#)) is used. This serves as a shield against lead leaching into the water from aged residential water pipes and service lines.

The quality and safety of the water is tested by an in house laboratory at every stage of the treatment process. The final product is pumped through the water mains to the community, where further tests are conducted from samples taken throughout the city, including private homes, businesses and public facilities ensuring that water continues to remain high in quality and safety, at your tap.

Water Treatment Schematic

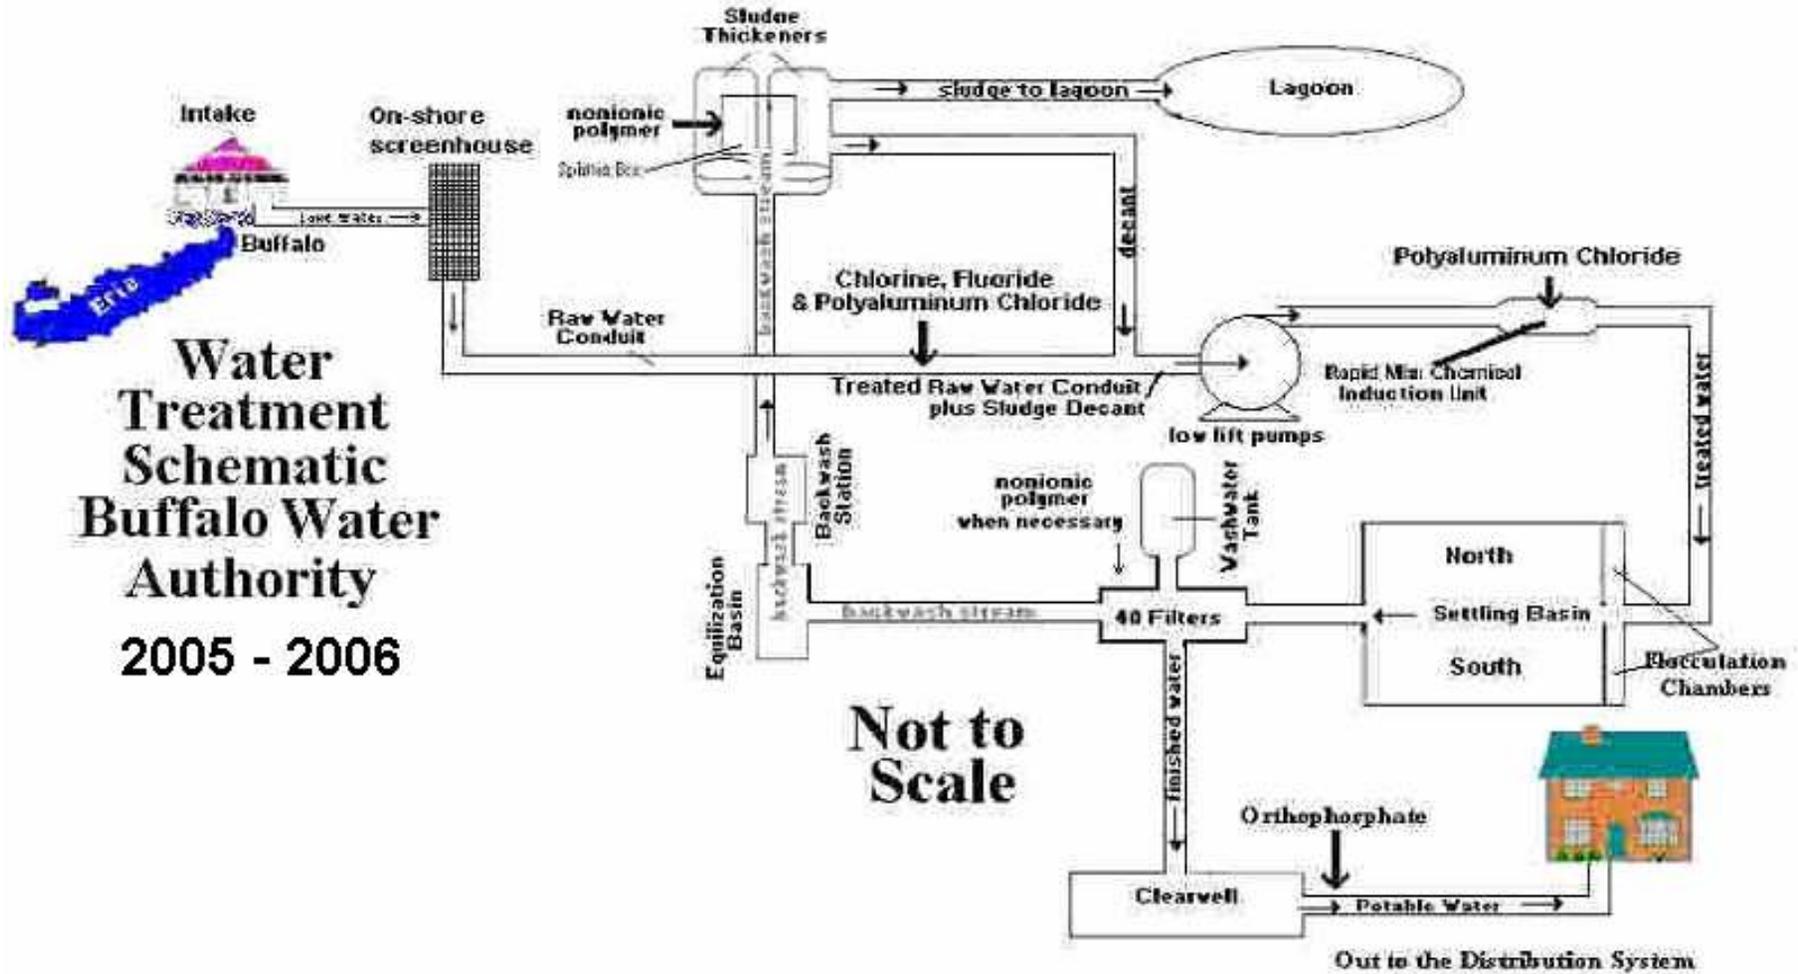

Water Treatment Schematic
Buffalo Water Authority
2005 - 2006

Water Distribution



Water is essential for all life. Besides drinking, bathing and recreation, water is used to fight fire, and has countless industrial applications. The City of Buffalo treated 29 billion gallons last year with an average of 79 million gallons each day to a population of approximately 290 thousand people, covering 46 square miles of piping network. This water must be transported, after treatment, throughout the city. Pumps transport the treated water from a 28 million-gallon [clear well](#),

located below the filter beds, through two large conduits. The water travels through 800 miles of pipes and 25,000 valves to 80,000 service connections and 7,800 fire hydrants.

This enormous network of pipes, valves, service connections and hydrants is maintained, day and night, throughout all seasons. In the past year the Buffalo Water Authority has replaced or renovated approximately 2.13 miles of water mains.

[Back](#) [Table of Contents](#) [Next Page](#)

Customer Costs

Our customer's billing rates are among the lowest in the state. **The average 2005 annual water bill was only \$323.16 per year.** The total quarterly bill includes the cost of water used and the service charge. Senior Citizens receive a significant discount.

Water Usage (Gallons)	Price per 1000 gal	
	Regular	Senior
Up to 74,805	\$2.54	\$1.53
Over 74,805– 269,299	\$2.26	\$1.35
Over 269,299	\$1.73	50¢

Quarterly Service Charge For 2005				
Meter Size	Regular Rate	Senior Rate	Meter Size	Regular Rate
5/8"	\$23.82	\$14.28	3"	\$357.24
3/4"	\$35.73	\$21.51	4"	\$595.38
1"	\$59.58	\$35.73	6"	\$1190.79
1 1/2"	\$119.10	\$71.55	8"	\$1931.07
2"	\$190.53	\$114.30	10"	\$2738.85
Senior rates not applicable for meters over 2"				



[Back](#)

[Table of Contents](#)

[Next Page](#)

Facts About Cryptosporidium

Cryptosporidium is a parasite that lives and multiplies in the intestines of warm-blooded animals. Its eggs are shed through feces, where they can enter lakes, reservoirs and other sources of drinking water. When exposed to adverse conditions, these eggs can form a spore so rugged that they become impervious to even concentrated bleach.

Once the spore is ingested, an intestinal illness called *Cryptosporidiosis* may result. The incubation period may range from 1 - 12 days. *Cryptosporidium* can be spread by person-to-person, or animal-to person contact, and by drinking contaminated water.

Human *Cryptosporidiosis* was first reported in 1976. The primary symptom is acute diarrhea. Other symptoms include abdominal pain, vomiting, headache, loss of appetite and a low-grade fever.

Some persons infected with *Cryptosporidium* will not become ill, but others may be especially susceptible to *Cryptosporidiosis*. In most individuals with normal immune systems, symptoms generally persist for two weeks or less. But immunocompromised persons, including individuals receiving chemotherapy and kidney dialysis patients, persons on steroid therapy, and those with Crohn's disease or HIV/AIDS, may have severe and long-lasting illness.

Properly operated water treatment procedures are effective in providing a barrier to *Cryptosporidium* and other pathogenic microorganisms from reaching the distribution system. Due to their high resistivity to chlorine, normal disinfection methods are ineffective against these parasites. Proper filtration of these small tough organisms, including the coagulation and sedimentation processes, is the most important vehicle in their control and elimination.

Cryptosporidium is spread through contact with fecal matter. One can minimize the risk of acquiring and spreading this parasite by cleansing hands after fecal contacts such as after toilet use, diaper changing and picking up pet waste. Since cattle are a common source, avoid drinking raw milk, and cleanse hands after contact with any farm animals. Avoid drinking unfiltered water, and comply with any water advisory issued by local and state authorities. If uncertain about the quality of a water supply, exposing water to a rolling boil for at least one minute will kill *Cryptosporidium*.

Bottled water, unless distilled or certified for cyst removal may contain *Cryptosporidium*. Current standards for bottled water do not guarantee that it be *Cryptosporidium*-free.


If home water filters are used, filters should have a pore size of less than 2 microns. Home filters should be certified for cyst removal by the National Sanitation Foundation (NSF; Standard #53).



Facts About Giardia

Giardia is a microbial pathogen present in varying concentrations in many surface waters and ground water under the influence of surface water. It is removed/inactivated through a combination of filtration and disinfection or by disinfection.

Ingestion of Giardia may cause giardiasis, an intestinal illness. People exposed to Giardia may experience mild or severe diarrhea, or in some instances, no symptoms at all. Fever is rarely present. Occasionally, some individuals will have chronic diarrhea over several weeks, with significant weight loss. Giardiasis can be treated with anti-parasitic medication. Individuals with weakened immune systems should consult with their health care provider about what steps would best reduce their risks of becoming infected. Anyone who thinks they may have been exposed to Giardiasis should contact their health care provider immediately. The Giardia parasite is passed in the feces of an infected person or animal and may contaminate water or food. Person to person transmission may also occur in day care centers or other settings where hand-washing practices are poor.

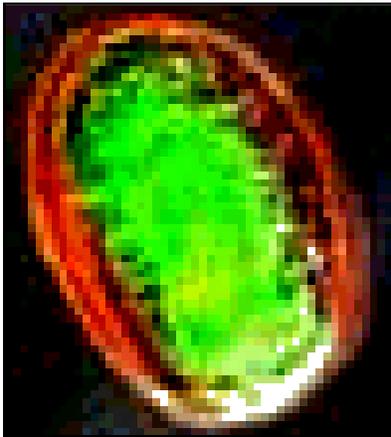

Microscopic
view of giardia




Giardia invading
human intestines

[Back](#) [Table of Contents](#) [Next Page](#)

Facts About Radon

Radon is a naturally occurring radioactive gas that may cause cancer, and may be found in drinking water and indoor air. Some people who are exposed to radon in drinking water may have increased risk of getting cancer over the course of their lifetime, especially lung cancer. Radon in soil under homes is the biggest source of radon in indoor air, and presents a greater risk of lung cancer than radon in drinking water.

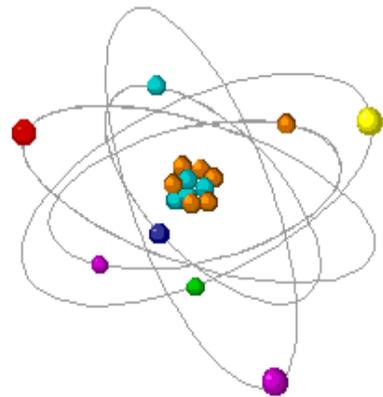

Radon's Physical Properties

Radon, in this text, refers to the specific isotope radon-222.

Radon is a naturally occurring gas formed from the radioactive decay of uranium-238. Low concentrations of uranium and its other decay products, specifically radium-226, occur widely in the earth's crust, and thus radon is continually being generated, even in soils in which there is no man-made radioactive contamination. Radon is colorless, odorless, tasteless, chemically inert, and radioactive. A portion of the radon released through radioactive decay moves through air or water-filled pores in the soil to the soil surface and enters the air, while some remains below the surface and dissolves in ground water (water that collects and flows under the ground's surface). Because radon is a gas, when water that contains radon is exposed to the air, the radon will tend to be released into the air. Therefore, radon is usually present in only low amounts in rivers and lakes. If ground water is supplied to a house, radon in the water will tend to be released into the air of the house via various water uses. Thus presence of radon in drinking water supplies leads to exposure via both oral route (ingesting water containing radon) and inhalation route (breathing air containing both radon and radon decay products released from water used in the house such as for cooking and washing).

Radon itself also decays, emitting ionizing radiation in the form of alpha particles, and transforms into decay products, or "progeny" radioisotopes. It has a half-life of about four days and decays into short-lived progeny.

Unlike radon, the progeny are not gases, and can easily attach to and be transported by dust and other particles in air. The decay of progeny continues until stable, non-radioactive progeny are formed. At each step in the decay process, radiation is released.

[Back](#) [Table of Contents](#) [Next Page](#)


Zebra Mussels

The zebra mussel is a small freshwater shellfish native to the Black & Caspian seas of western Russia. They were introduced into European waters in the 18th Century. By 1986 the mollusks were transported to North America from freshwater European ports, through the discharge of ballast tanks from international shippers.

They are prolific breeders. Each female can produce up to 40,000 eggs each year. Using elastic-like fibers they can attach to any hard surface and quickly colonize large areas, reaching densities of more than 100,000 per square meter. They feed by filtering water containing microorganisms through their gill system.

Once the zebra mussels invaded Lake Erie they spread like wildfire. Their impact on Lake Erie has been profound. Nearly all particulate matter is strained from the lake's water. Uneaten suspended matter is bound with mucous and amassed among the shells in its immense colonies. Because of this filtering activity, the clarity of Lake Erie has greatly improved, allowing light to penetrate much deeper, and with much greater intensity than ever before.

Unfortunately this phenomenon has serious consequences to the lake's ecosystem and water quality. Besides severely affecting the aquatic food chain, this increase in light intensity causes the foul summertime taste and odor problem. The additional light entering the lake causes a steep acceleration in the blue-green algae growing cycle, the main source of taste and odor problems.

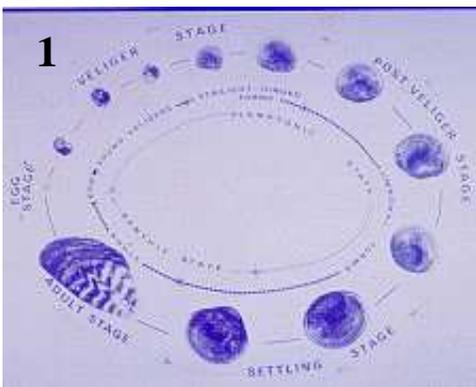

(1) Life cycle of the zebra mussel; (2) Zebra mussel close-up; (3) beach wash-up of zebra mussels

Metering Program

This program has been mandated by New York State's Department of Environmental Conservation. In general, the water meter project will either replace existing meters or "convert" all flat rate water service to metered accounts using the most automated water meters available. These meters can be read from outside the home and accurately bill you for the amount of water that has been used, in the same way that you are currently billed by other utilities.

FLAT RATE TO METERED BILLING CONVERSIONS IMPORTANT INFORMATION ABOUT YOUR NEW METER



Maintenance: Your new meter should register and run without any problems for fifteen years or more. The City of Buffalo owns and maintains the meter only and will replace any meter that fails due to mechanical problems at no charge to you. There is a charge for repairing meters, cables or remotes that are damaged willfully or through the neglect of the property owner. Meters must be protected from freezing if they are located in an unheated area.

Meter Reading: The remote reading device placed on the outside of your home allows us to accurately read the meter without entering your home. Please do not disturb the remote device or the wire between it and the meter, or place any objects directly in front of the remote device that would make access to this device difficult for the meter reader.

Meter Billing: The City of Buffalo currently reads and bills metered accounts quarterly. Metered customers are billed for the actual amount of water used during the quarterly period; bills are processed and mailed within approximately 30 days following the previous quarter. Plans are currently being reviewed to change to monthly billing for metered customers; you will receive information about this change in the future.

Billing Cycle: Depending upon the timing of your new meter installation, you may receive a flat rate bill for your property before the new-metered account is set up. If you have already received a flat rate bill, or receive one before the metered account is established, please disregard this bill. You will receive a notice from the billing department with information regarding any credits or monies owed on your flat rate account. Because of the time required to set up a new-metered account, it could take anywhere from 30 to 60 days to process this new account. Even though your first metered bill may be delayed, you will still only pay for the amount of water you actually used.

Water Conservation

Water is a vital and limited resource. It is crucial to conserve water. Between the years 1980 and 2000 Americans have more than doubled their water usage. In many areas severe shortages already exist. We must learn to conserve water now, to avoid severe shortages in the future.

By saving water you can also reduce your water, sewer, and utility bills while easing the burden on water storage, purification, distribution, and treatment.

There are four basic ways to save water: economize, repair leaks, install water-saving devices, and reuse water.

Water Savings Tips

The following are some water saving suggestions that you may find useful:

- Dishwashing: Wash dishes in standing water after you wipe grease off dishes with a paper towel or cloth. Turn off faucet frequently, and you will save over 20 gallons of water a day. Soak pots and pans before washing.
- Tooth brushing: Don't let water run while you brush your teeth. Rinse your mouth with water in a glass and you will save over a gallon of water each time you brush.
- Shower & Bath: Plug the drain before you run water. Take shallow baths. Keep showers short with pressure at low force. Bathe small children together. Reuse bath water to use on lawns and shrubs, and for heavy cleaning jobs (e.g. floors, cars, etc.).
- Sink: Fill bowl with water instead of letting water run when you wash or shave. Try a faucet aerator to reduce the amount of water used.
- Toilet: Flush only when necessary. Don't use as a wastebasket for cigarette butts or disposable diapers. Install water saving displacement devices. " *When it's yellow, let it mellow, when it's brown, flush it down*"
- Laundry: More than 10% of all water used in the home is used in the washing machine. Use the load selector to match water level to size of load. Try to wash full loads whenever possible. Presoak heavily soiled items. If buying a new washing machine, choose one with conservation features.
- Cleaning: Use a pail or basin instead of running water. Use sponge mops instead of string mops (uses less water for mopping and takes less water to keep clean).
- Lawn & Garden: Water slowly and thoroughly during cool, shady, and windless times of the day. Let grass grow taller in hot weather. Use judicious amounts of mulch in the garden and around shrubs to conserve moisture. Plant shrubs that don't need a lot of watering.
- Car Washing: Wet car quickly, turn hose off, wash car from a bucket of soapy water, and rinse quickly with hose. Used water is fine for cleaning chrome, hubcaps, and wheels.

More Water Savings Tips

Leak Detection

- Check the small red (leak detection) dial, found between the 7 & 8 on the face of the new water meter. If this dial is turning when you think the water is not being used, this indicates a leak somewhere inside the house.
- Check for leaks from faucet. A slow drip can waste 15 to 20 gallons a day, fix it and save 6,000 gallons per year. Most leaks are caused by worn out washers, which often can be repaired by the homeowner.
- Check for leaks from toilet tanks by putting a few drops of food coloring in the tank. Without flushing; wait 10 to 15 minutes; if the color shows up in the bowl, you have a leak. It's possible to lose up to 100 gallons a day from an "invisible leak", that's more than 30,000 gallons per year. Nearly 90% of all residential leaks are caused by leaks from toilet tanks.
- Check for leaks from tub faucets and showers. Replacing old showerheads with low flow models can save 5 to 10 gallons per minute.

• Detect for leaks on service lines by listening for a "hissing" noise at your water meter when no water is being used inside the house. You could have a water line that goes to another building, such as: (1) front house to rear building; (2) house to garage. If you suspect a problem, you should contact your plumber to check this out.

Water Loss In Gallons					
Leak this Size	Loss Per Day	Loss Per Month	Leak this Size	Loss Per Day	Loss Per Month
•	120	3,600	●	6,640	199,520
•	300	10,800	●	6,964	209,520
•	693	20,790	●	8,424	252,720
•	1,200	36,000	●	9,585	296,640
•	1,920	57,600	●	11,324	339,720
•	3,095	92,880	●	12,750	361,600
•	4,295	128,880	●	14,952	448,560

* Note that water loss due to leaks in a multi-family building are multiplied by the number of units in the complex.

[Back](#) [Table of Contents](#) [Next Page](#)

Consumer Tips

→Appearance

If your cold tap water appears brown or red it is probably mineral deposits (tuberculation) in your water caused by:

- Water main break
- Water or sewer workers flushing fire hydrants
- Vibrations caused by construction
- Children playing with fire hydrants

To report these problems, call the water dept. at 851-4704 or 851-4749. Once the reason has been identified and the disruption of the water main has ceased, run your cold water tap until it clears.

- If your water appears cloudy in winter or early spring it is most likely trapped air. Cold water has a much greater capacity to hold gas than warm water, and if this tendency is combined with a faucet aerator, your water may appear cloudy due to air bubbles. If the water is allowed to sit for a short while, the bubbles will eventually rise to the surface and dissipate.

→Taste & Odor

■After chlorination there remains a minute amount of chlorine in tap water known as residual chlorine. This residual is necessary to kill pathogenic organisms in the water. Many consumers dislike the inherent taste. The following are some ways to eliminate or improve this taste:

- Expose water, in a clear uncapped bottle, to sunlight for one hour, and the smell of chlorine will be removed.
- Cool water to less than 60°F in the summer. Cool water definitely tastes better. If the smell of chlorine is removed before cooling, the taste will be much better.
- Leave water in a kettle overnight. The smell of chlorine will be removed.
- Boil water for 5 minutes in a kettle with the lid off, cool to room temperature, then place in a refrigerator with the lid on, but not air tight, until cool.
- A well-maintained point-of-use charcoal filter will eliminate the smell of chlorine.

■Another common cause of taste & odor in tap water are PVC supply lines. PVC can impart a bitter medicinal taste to water that is allowed to stagnate within a supply line. To eliminate this problem, run the water until the taste & odors has dissipated or change the supply line to a material other than PVC.

■A non-functional drain trap can give the illusion of a sewage smell in tap water. This is due to the introduction of sewer gas from the drain whenever water is flowing through it. Repairing the drain trap will eliminate this problem.

(FAQ) Frequently Asked Questions ...

Water Quality Questions:

- 1 My water appears milky, cloudy or white, when poured in a glass it clears from bottom to top, is it safe to drink?

Yes, your water is safe to drink. The cloudiness is simply air. Air-bound water is most frequently seen when the water temperature is colder than the ambient air. This effect may be enhanced when an aerator is attached to the faucet's tap. The presence of air-bound water is not harmful and no action needs to be taken to correct this phenomenon.

- 2 Why does my water appear brown or orange, when it is not used for a while?

This is probably due to rust within your internal plumbing at your residence. We suggest you let the water run for a few minutes, until it clears, before use.

- 3 Why is our whole neighborhood experiencing brown or orange water coming out of the tap?

Call the water department at 851-4704 or 851-4747. We will check to see if work is being done in your neighborhood. Often, when a nearby hydrant is being used, or vibration from construction activity is occurring, the flow of water in the main is upset or interrupted. This may cause minerals deposited on the walls of the main, to detach and become suspended in the water.

We suggest that you, and your neighbors, run the water for a time. The greater the water usage in your area, the faster the minerals deposited in your water will clear. If possible, run the water from the cold-water tap closest to your water meter. This may prevent these minerals from traveling to other faucets farther along your water pipes. Once the water clears, it may be necessary to remove, and clean any aerators that are attached to you faucets.

- 4 Why is there a black ring inside my toilet bowl?

This has nothing to do with water being delivered to your household. This is mildew caused by room temperature, facility usage and lighting. We suggest a chlorine-based bowl cleaner, and more ventilation during showers.

- 5 What are the particles that are clogging my aerator, dishwasher hoses, etc.?

Let's do a quick test to see what these particles are. Collect some of these particles and place them in a small cup. Slowly and carefully pour a small amount of household vinegar in this cup. If these particles dissolve in the vinegar, they are probably mineral deposits. It is quite natural to see small amounts of minerals coming from your water pipes.

But

If the particles do not dissolve in vinegar, they may be plastic coming from the “dip tube” in your hot water tank. This broken down “dip tube” material closely resembles mineral deposits, but are much more abundant. When the plastic “dip tube” in a hot water tank begins to disintegrate it may wreak havoc in your plumbing. You will eventually notice a loss of hot water pressure, along with blocked aerators and hoses. The “dip tube” or possibly the entire hot water tank may need to be replaced.

6 Why does my water taste and smell like algae, or grass or dirt?

During the end of summer through fall you may notice a foul taste and odor in your water. This is an after taste do to the presence of algae in Lake Erie. We do remove, filter and disinfect algae in the production of finished water, but often the aftertaste will remain (see [Aesthetic Qualities](#) for details). Despite the taste & odor, your water is perfectly safe to consume. We suggest you place a container of water in your refrigerator. The colder the water, the less noticeable the taste.

7 I have a skin rash, is the water to blame?

You may have dry skin, or any number of different skin ailments (e.g. eczema), that become irritated when in contact with water. Water does not create these ailments, but the ailments may become worse when it comes in contact with water because instead of hydrating the skin, water may draw moisture away from your skin. Talk to your doctor or pharmacist regarding a remedy.

8 Why did all my fish die, after I put fresh water in my aquarium?

Tap water contains residual chlorine to keep it disinfected. This residual chlorine is deadly to fish. Before adding tap water to a fish tank it is necessary to dechlorinate the water. This can be achieved by adding a dechlorination agent, available at any pet supply store. You can also collect a quantity of water in an open container, and allow the chlorine to dissipate naturally.

9 Why does my water smell like bleach?

This is a normal smell when using tap water. We add chlorine to water to keep it disinfected. At certain times of the year the chlorine smell is more noticeable. This is especially apparent when the water temperature is warmer than air temperature.

Chlorine, like all gases, will travel from a warm environment to a colder one. This phenomenon is the driving force of lake effect snow as well as chlorine gas in water.

If you find the chlorine smell objectionable, try placing a container of chlorine in your refrigerator overnight. The chlorine will escape and the chlorine odor will be gone. This water should be kept in your refrigerator because it will no longer have chlorine in it to keep it disinfected.

(FAQ) Frequently Asked Questions ...

Metering Questions

- 1 Why am I still receiving a water bill even though my water is turned off at the property I own?

You must fill out a disconnect request and pay the turn off fee at our Customer Service office at 281 Exchange Street (or request a disconnect request be mailed or faxed to you). Before the billing can be inactivated the meter must be removed. If you are a flat rate customer, your account will be researched back to the turn off date, and a new bill will be issued, if appropriate.

Note: Water turned off for repairs or nonpayment, are not considered disconnect requests, and will not be treated as such.

- 2 Why am I being billed for your frozen and ruined water meter?

Per city ordinance, whenever a water meter is placed in a property, it is the owner's responsibility to prevent the water meter from freezing. Examples to prevent water meters from freezing are placing insulation around the meter, or making sure the meter area is heated or away from drafts.

- 3 I don't think my meter has been read, how do I know if it was?

There will be an "E" next to the reading on your bill if the meter has not been read. The meter reading should only be estimated when the meter reader is unable to obtain a reading due to access problems or touchpad malfunction. Customers should be referred to the Meter Shop to investigate estimated readings.

- 4 I think my water bill is awfully high, how much water should I be using?

Although everyone is different, the average household should be using approximately one thousand cubic feet (1000 ft³) per person per year).

- 5 I received a notice of high consumption and made arrangements with the Meter Shop to check for leaks. They found the leaks and I made the repairs. How can I prevent being surprised again?

Residential meters are read once every 3 months, or quarterly, yet a property owner can monitor their readings as often as they like, to prevent surprises like high water bills. The meter readings should be monitored by the owner at least monthly. In addition, all water meters have a low flow indicator located between the seven and eight on the face of the water meter. This little red triangle will be moving if water is running through the meter, if your not using water when it is moving, you should check all fixtures for leaks.

2005 System Improvements

To insure continuing quality and safety in our communities' water supply, the Buffalo Water Authority has made the following improvements to our system in 2005

- South Basin Sluice Gates Operators rehabilitated.
- Optimization of filter-aid, with PACl 50: Enhancing filtration and reducing cost.
- Metering program. Metering will encourage water conservation and curtail unaccounted water.
- Leak Detection: To reduce non-revenue water usage and optimize water treatment and pumpage.
- Security cameras at all water tanks and remote pump stations.
- SCADA (system monitoring and control) upgrade at the Col. Ward Pump Station, which allows for monitoring and remote control of all water tanks and remote pump stations.
- Peristaltic feed pumps replaced diaphragm pumps at Treatment Plant: optimizing chemical addition and eliminating wasteful siphoning.

Future of Buffalo's Water System

On September 1997 the City of Buffalo commissioned AmericanAnglian Environmental Technology (AAET) to manage the Buffalo Water Authority. AAET was a joint venture between American Water (the largest US water utility) and Anglian Water. Together, they operate over 1000 treatment plants, servicing 13 million people in 5 continents. In 1999 American Water took over Anglian Water's interest in AAET and the company was renamed American Water Services, Inc. TM and in 2004 became American Water.

To insure continuing quality and safety in our communities' water supply, the Buffalo Water Board plans the following improvements to our treatment & distribution systems in 2006

- Filter rehabilitation: More effective backwash will increase water quality and lower its cost.
- Continuing the Metering Program & Leak Detection
- Homeland Security: Security upgrades including doors, windows, fencing & surveillance cameras.
- Pump & Motor rehabilitation: Better water pressure control will reduce water main breaks.
- South Basin Rehabilitation (Baffle Curtains): Allowing more effective sludge removal.
- Expanded reporting ability for turbidity monitoring system: allowing enhanced historical data logging.
- Ongoing installation of "Radio Read Meters" for commercial & industrial customers; improves efficiency of meter reading and billing.
- Increase in capitol program to replace ageing water mains: improving water quality and flows.
- SCADA upgrade at the Filter Plant: Optimizing control over water treatment systems

[Back](#) [Table of Contents](#) [Next Page](#)

[Back to: Table of Contents](#)

ARE THERE CONTAMINANTS IN OUR DRINKING WATER?

As the State regulations require, we routinely test your drinking water for numerous contaminants. These contaminants include: total coliform, turbidity, inorganic compounds, nitrate, nitrite, lead & copper, volatile organics compounds, total trihalomethanes, and synthetic organic compounds. The following table depicts which compounds were detected in your drinking water. The State allows us to test for some contaminants less than once per year because the concentrations of these contaminants do not change frequently. Some of our data, though representative, are more than one year old. It should be noted that drinking water, including bottled water, might reasonably be expected to contain at least small amounts of some contaminants. The presence of contaminants does not necessarily indicate that water poses a health risk. More information about contaminants and potential health effects can be obtained by calling the EPA's Safe Drinking Water Hotline (800-426-4791) Although our drinking water met or exceeded state and federal regulations, some people may be more vulnerable to disease causing microorganisms or pathogens in drinking water than the general population. Immuno-compromised persons such as persons with cancer undergoing chemotherapy, persons who have undergone organ transplants, people with HIV/AIDS or other immune system disorders, some elderly, and infants can be particularly at risk from infections. These people should seek advice from their health care provider about their drinking water. EPA/CDC guidelines on appropriate means to lessen the risk of infection by Cryptosporidium, Giardia and other microbial pathogens are available from the Safe Drinking Water Hotline (800-426-4791).

2005 Table of Detected Contaminates: Inorganics									
Contaminant	Any MCL of TT violation?	Sample Date (or highest detected)	Max Level Detected	Unit	MCLG	MCL	Range	Likely Source of Contamination	
Entry Point	BARIUM	No	4/5/05	0.021	ppm	2	2	N/A	Erosion of natural deposit. Discharge from: drilling waste & metal refineries
	CHROMIUM	No		8.3	ppb	100	100		Discharge from steel and pu:p mills; Erosion of natural deposits
	FLUORIDE	No	9/26/05	1.28	ppm	N/A	2.2	0 - 1.28	Erosion of natural deposit; water additive that promotes strong teeth; Discharge from fertilizer and aluminum factories
	NICKEL	No	4/5/05	1.5	ppb	100	100	N/A	Naturally-occurring mineral
	NITRATE-N	No		0.36	ppm	10.0	10.0		Run-off from fertilizers; leaching from septic tanks & sewage; erosion of natural deposits
	SODIUM	No		10		N/A	**		Naturally-occurring; Road salt; Water softeners; Animal waste
	SULFATE	No		22		N/A	250		Naturally-occurring mineral

** Water containing more than 20 mg/l of sodium should not be used for drinking by people on severely restricted sodium diets. Water containing more than 270 mg/l of sodium should not be used for drinking by people on moderately restricted sodium diets.

The EPA's Safe Drinking Water Hotline is: (800-426-4791).

2005 Table of Detected Contaminates: Radioactive									
Entry Point	Radioactive Contaminants	Any MCL of TT violation?	Sample Date (or highest detected)	Max Level Detected	Unit	MCLG	MCL	Range	Likely Source of Contamination
	Co60	No	9/29/03	3.1	pCi/L	0	50	0 - 3.1	Decay of natural products and man-made emissions
	Cs134	No	3/31/03	7.5				0 - 7.52	
	Cs137	No		1.4				0 - 1.38	
	*Gross β	No	9/29/03	2.3				1.3 - 2.3	
	Gross α	No	12/9/03	0.400			15	0 - 0.4	Erosion of natural deposits
	Ra226	No		0.3			5	0 - 0.3	
	Ra228	No		2.5			0 - 2.5		

*The State considers 50 pCi/l to be the level of concern for beta particles. Our highest reading was only 2.3 pCi/l on 9/29/03

The EPA's Safe Drinking Water Hotline is: (800-426-4791).

2005 Table of Detected Contaminates: Lead & Copper									
	Contaminant	Any MCL of TT violation?	Sample Date (or highest detected)	Max Level Detected	Unit	MCLG	AL	Range	Likely Source of Contamination
distribution	COPPER ⁽¹⁾	No: 90% = .055ppm	7/6/05	0.21	ppm	1.3	1.3	ND - 0.21	Corrosion of household plumbing; erosion of natural deposits; leaching from wood preservatives.
	LEAD ⁽¹⁾	No: 90% = 3.9ppb	8/25/05	21	ppb	0	15	ND - 21	Corrosion of household plumbing; erosion of natural deposits.

(1) Out of 55 homes tested, in 2005 only one was above the AL of 15 ppb for Lead (21 ppb). The TT employed by the Buffalo Water Authority, intended to reduce lead contamination of drinking water is the addition of a poly/ortho-phosphate blend as a part of water treatment. This chemical serves to coat water lines, to prevent lead from leaching into the drinking water. Infants & children who drink water containing lead in excess of the AL could experience delays in their physical or mental development. Children could show slight deficits in attention span and learning disabilities. Adults who drink this water over many years could develop kidney problems or high blood pressure. Infants & young children are more vulnerable to lead in drinking water than the general population. Lead levels in your home might be higher than at other homes in the community as a result of materials used in your home's plumbing. If you are concerned about elevated lead levels in your home's water, you may wish to have your water tested, and you should flush your tap for 30 seconds – 2 minutes before using your tap water.

The EPA's Safe Drinking Water Hotline is: (800-426-4791).

2005 Table of Detected Contaminates: Microbiological									
Contaminant		Any MCL of TT violation?	Sample Date (or highest detected)	Max Level Detected	Unit	MCLG	AL	Range	Likely Source of Contamination
distribution	Heterotrophic Bacteria	No	9/14/05	49	count / ml	N/A	N/A	0 - 49	Naturally occurring soil runoff
	Turbidity ⁽²⁾	No	6/29/05	0.6	NTU		TT >5.0 NTU	0.07 - 0.6	
Entry Point		No	11/13/05	0.56			TT: 95% samples not ?0.5NTU	0.04 - 0.56	

Turbidity is a measure of the cloudiness of the water. We monitor it because it is a good indicator of the effectiveness of our filtration system. Our highest single measurement for 2005 occurred on 6/29/05 (0.60 NTU). State regulations require that turbidity must always be below 5.0 NTU. The regulations require that 95% of the turbidity samples collected have measurements below 0.5 NTU. Although November was the month that had the fewest distribution measurements meeting the TT for turbidity (1 sample over 0.5), the levels recorded were in the acceptable range allowed and did not constitute a violation.

The EPA's Safe Drinking Water Hotline is: (800-426-4791).

2005 Table of Detected Contaminates: Disinfection By-products formed by chlorination of tap water, and their precursors									
Contaminant		Any MCL of TT violation?	Sample Date (or highest detected)	Max Level Detected	Unit	MCLG	AL	Range	Likely Source of Contamination
Entry Point	Total Chlorine	No	12/17/05	1.81	ppm	N/A	N/A	0.89 - 1.81	Water additive used to control microbes
	Free Chlorine	No	12/17/05	1.59		(MRDLG) 4.0	(MRDL) 4.0	0.89 - 1.59	
		No	2/10/05	1.25				0.2 - 1.25	
distrib	TTHM ⁽³⁾	No: RAA= 30.1ppb	8/9/05	46.9	ppb	N/A	TT=80ppb	17.8 - 46.9	By-product of drinking water chlorination needed to kill harmful microorganisms. TTHM's are formed when source water contains large amounts of organic matter.
	HAA	No: RAA= 18.1ppb	8/9/05	23.9			TT=60ppb	12.1 - 23.9	By-product of drinking water disinfection needed to kill harmful microorganisms
Entry Point	TOC	No	7/18/05	2.5			ppm	TT = TOC & SUVA >2.0	1.6 - 2.5
	SUVA	No	2/15/05	1.04	L/mg-m	0.2 - 1.04			

Representative testing for TTHM included 8 samples collected through 2005 (sites tested quarterly). Our highest detected reading occurred in Aug. It was 47 ppb, well below the MCL of 80 ppb. Some people who drink water containing TTHM in excess of the MCL over many years experience problems with their liver, kidneys, or central nervous systems, and may have an increased risk of getting cancer.

The EPA's Safe Drinking Water Hotline is: (800-426-4791).

2005 Table of Detected Contaminates: Other Properties of Tap Water									
Contaminant	Any MCL of TT violation?	Sample Date (or highest detected)	Max Level Detected	Unit	MCLG	AL	Range	Likely Source of Contamination	
Entry Point	Total Solids	No	1/31/05	193.5	ppm	N/A	N/A	154.5 - 193.5	Naturally occurring minerals
	Total Dissolved Solids	No		232				148 - 232	
	Alkalinity	No	3/8/05	99.8				86 - 99.8	
	Calcium Hardness	No	2/15/05	94				85.5 - 94	
	pH	No	8/21/05	8.1	SU	7.3 - 8.1	Naturally occurring		

The EPA's Safe Drinking Water Hotline is: (800-426-4791).

What does this information mean?

As you can see by the table, our system had no violations. We have learned through our testing, that some contaminants have been detected; however, these contaminants were detected below the level allowed by the State.

[Back](#) [Table of Contents](#) [Next Page](#)

2005 Raw Water Data

Parameter	units	avg	range	max date	# of tests
Total Solids	PPM	179.20	162.5 - 197	10/31/05	9
Total Dissolved Solids	PPM	175.20	147.5 - 214	1/31/05	9
Calcium Hardness	PPM	90.80	88 - 99.5	2/15/05	12
Alkalinity	PPM	95.30	87.3 - 99.8	2/15/05	12
Turbidity	NTU	3.25	0.15 - 60.0	11/7/05	2420
pH	SU	8.1	7.5 - 8.3	9/13/05	1304
Fluoride	PPM	0	N/A	N/A	211
Coliform	count per 100ml	24	0 - 500	11/10/05	178
Standard PlateCount	count per ml	71	0 - 1000	1/3/05	140

Undetected contaminants

Below is a list of contaminants that were tested for in 2005, but were not detected in our drinking water:

1,1,1-TRICHLOROETHANE, 1,1,2-TRICHLOROETHANE, 1,1-DICHLOROETHYLENE, 1,2,4-TRICHLOROBENZENE, 1,2-DIBROMO-3-CHLOROPROPANE, 1,2-DIBROMOMETHANE, 1,2-DICHLOROETHANE (ORTHO), 1,2-DICHLOROETHANE, 1,2-DICHLOROPROPANE, 1,4-DICHLOROETHANE (PARA), 2,4,5-TP(SILVEX), 2,4-D, 3-HYDROXYCARBOFURAN, ALDICARB, ALDICARB SULFONE, ALDICARB SULFOXIDE, ANTIMONY, ARSENIC, BENZENE, BERYLLIUM, CADMIUM, CARBARYL, CARBOFURAN, CARBON TETRACHLORIDE, CHLOROBENZENE (MONO), CIS-1,2-DICHLOROETHYLENE, CYANIDE, DALAPON, DICAMBA, DINOSEB, DIQUAT, ENDOTHALL, ETHYLBENZENE, GLYPHOSATE, HEXACHLOROCYCLOPENTADIENE, IRON, MANGANESE, MERCURY, METHOMYL, NITRITE-N, OXAMYL (VYDATE), PCB 1016, PCB 1221, PCB 1232, PCB 1242, PCB 1248, PCB 1254, PCB 1260, PENTACHLOROPHENOL, PICLORAM, SELENIUM, SILVER, STYRENE, TETRACHLOROETHYLENE (PCE), THALLIUM, TOLUENE, TOXAPHENE, TRANS-1,2-DICHLOROETHYLENE, TRICHLOROETHYLENE (TCE), VINYL CHLORIDE, XYLENES, TOTAL, ZINC

Is our water system meeting other rules that govern operations?

During 2005, our system was in compliance with all applicable state drinking water operating, monitoring and reporting requirements.

CLOSING

Thank you for allowing us to continue to provide your family with quality drinking water this year. We ask that all our customers help us protect our water sources, which are the heart of our community. Please call our treatment plant laboratory @ 716-851-4704 if you have questions about water quality.

[Back](#) [Table of Contents](#)